

# MONITORING THE EFFICIENCY OF COOLING AIR AT THE INLET OF GAS ENGINE IN INTEGRATED ENERGY SYSTEM

*Andrii RADCHENKO<sup>1</sup>, Ionut-Cristian SCURTU<sup>2</sup>, Mykola RADCHENKO<sup>1</sup>, Serhiy FORDUY<sup>3</sup>,  
Anatoliy ZUBAREV<sup>1</sup>*

<sup>\*1</sup>Admiral Makarov National University of Shipbuilding, Mykolaiv, Ukraine

<sup>2</sup>Mircea cel Batran Naval Academy, Romania

<sup>3</sup>PepsiCo, Inc., Kyiv, Ukraine

<sup>\*</sup>Corresponding author; E-mail: nirad50@gmail.com

*The fuel efficiency of gas engines is effected by the temperature of intake air at the suction of turbocharger. The data on dependence of fuel consumption and engine electric power on the intake air temperature were monitored for Jenbacher gas engine JMS 420 GS-N.LC to evaluate its influence. A waste heat of engine is rejected for heating water to the temperature of about 90 °C. The heat received is used in absorption lithium-bromide chiller to produce a cold in the form of chilled water. A cooling capacity of absorption chiller firstly is spent for technological needs and then for feeding the central air conditioner for cooling the ambient air incoming the engine room, from where the air is sucked by the engine turbocharger. The monitoring data revealed the reserves to enhance the efficiency of traditional cooling system of intake air by absorption chiller through deeper cooling. This concept can be realized in two ways: by addition cooling a chilled water from absorption chiller to about 5-7 °C for feeding engine intake air cooler or by two-stage cooling with precooling ambient air by chilled water from ACh in the first stage and subsequent deep cooling air to the temperatures 7-10 °C in the second stage of intake air cooler by using a refrigerant as a coolant. In both cases the ejector chiller could be applied as the most simple in design.*

*Key words: Engine, Intake Air Cooling, Absorption Chiller, Ejector Chiller.*

## 1. Introduction

Integrated energy systems (IES) driven by gas engines for combined cooling, heat and electricity supply received a widespread application [1, 2]. The gas engines, are manufactured as cogeneration modules with heat exchangers [3, 4] to reject the heat from lubricating oil, engine jacket cooling water, scavenge air and exhaust gas to produce hot water with temperature of about 90 °C. A hot water is used as a heat source for absorption lithium-bromide chiller (ACh) [5, 6] or adsorption chiller [7, 8] to produce a cold in the form of chilled water. A cooling capacity of absorption chiller is spent for technological needs and for feeding to the central air conditioner for cooling the ambient air incoming the engine room, from where the air is sucked by the engine turbocharger (TC) [9, 10]. The peculiarity of IES's that supply chilled water for food processing is its higher temperature of about

12 °C as compared with 7 °C typical for ACh. The use of water with a temperature of 12 °C as a coolant is not able to manage a stabilized low temperature of air at the intake of engine and provide its high fuel efficiency.

Deeper engine intake air cooling is possible by using a refrigerant as a coolant for engine intake air cooler. For this purpose the ejector chiller (ECh), the most simple in design, might be applied as an additional low-temperature chiller. In order to approve the expediency of such decision the data on influence of intake air on engine fuel efficiency are needed. They can be received by treating the monitoring data on engine fuel consumption at varying engine cyclic air temperature and power loading.

The goal of investigation is to evaluate the efficiency of cooling air at the intake of gas engine driving the IES by treating the monitoring data on dependence of fuel consumption and engine electric power as basis to develop decisions for its improvement, providing an enhancement of fuel efficiency of the engine.

## **2. Literature Review**

There are a lot of waste heat recovery technologies developed to enhance a fuel efficiency of combustion engines: by utilizing the exhaust heat [11, 12] and cooling engine cyclic air (intake and scavenge air) in electrically driven vapour-compression refrigeration machines [13, 14] and waste heat recovery chillers [15, 16]. The most widespread ACh's enable cooling air to the temperature of about 15 °C with a high coefficient of performance:  $COP = 0.7-0.8$  [17, 18]. The vapour-compression chillers provide cooling air practically to any low temperature but at the expense of consuming the electricity to drive the compressors [19, 20]. The refrigerant ejector chillers (ECh) are the most simple in design and able to provide cooling air to the temperatures of 5-10°C but with low  $COP = 0.2-0.3$  [21, 22].

The efficiency of refrigeration chillers and the whole cooling systems can be increased through intensification of heat transfer in heat exchangers [23, 24] first of all of refrigerant boiling in evaporators [25, 26] and by application of advanced coolant (refrigerant) circuits with injector [23, 27], evaporative [28, 29] and two-stage cooling [30] with heat conversion in combined chillers [31].

The energy saving technologies with accumulating cooling capacity at decreased thermal loads on the engine cyclic air cooling systems as well as for air conditioning systems to cover peak thermal loads are developed [31].

Many researches focused to improve the operating efficiency of cooling systems in the actual site climatic conditions [32, 33], optimization of air conditioning systems [34, 35] and to develop the methods of their rational designing [36, 37].

The majority of concepts and approaches to enhancing the efficiency of IES focus to application of cooling capacity generated in ACh for external consumers, for instance, for space conditioning and technological duties [38]. They do not reveal the reserves for improving the efficiency of cooling the cyclic air of engines themselves and enhancing the engine-generator technologies in the whole as result through using the generated cooling capacity within engine cycles [10, 17].

In order to approve the approach of enhancing the fuel efficiency of gas engine driving the IES, the data on influence of intake air temperature on engine fuel efficiency are needed. They can be

received by treating the monitoring data on engine fuel consumption at varying engine intake air temperature and loading.


### 3. Research Methodology

The efficiency of cooling air at the intake of gas engines was investigated for IES of the enterprise "Sandora"- "PepsiCo Ukraine". The IES includes two cogeneration modules based on Jenbacher gas engines JMS 420 GS-N.LC (rated electric power  $P_{elSO} = 1400$  kW, heat power  $Q_h = 1500$  kW). The heat rejected from lubricating oil, engine jacket cooling water, scavenge air-gas mixture and exhaust gas is converted in AR-D500L2 Century absorption Li-Br chiller to produce a refrigeration in the form of chilled water with a temperature of 12 °C. The refrigeration capacity is spent to cover the technological cooling needs and for feeding to the central air conditioner intended for cooling the ambient air incoming the engine room, from where the air is sucked by the engine turbocharger (Fig.1).



**Figure 1. A cogeneration gas engine module (a) and central conditioner for cooling the ambient air, coming into the engine room (b) of IES at the enterprise "Sandora"- "PepsiCo Ukraine"**

A typical waste heat recovery system of gas engine module based on ACh is shown in Fig. 2.

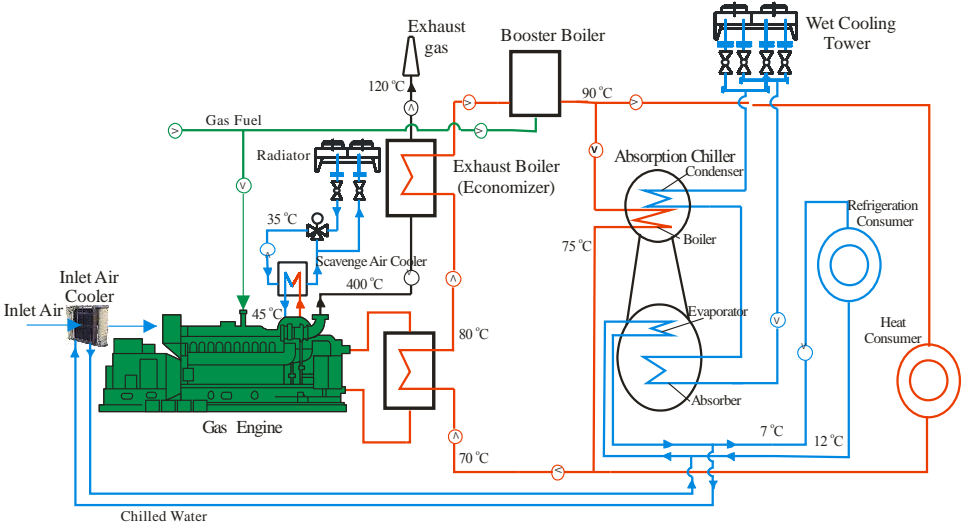

**Figure 2. A typical waste heat recovery system of cogeneration gas engine module based on ACh**

A method for treating the monitoring data on fuel consumption depending on the air

temperatures at the engine intake with regard to the influence of changes in engine loads was presented in [10, 30]. That method is modified by using for treatment of monitoring data the correlations from the generalized methodology presented in [39].

The purpose of treating the data sets on full volume fuel consumption  $G_f$  and electric power  $P_{el}$  is to find the data on specific volume  $b_f$  or mass  $b_e$  fuel gas consumption, i.e. full fuel consumption related to electric power, in dependence on the engine intake air temperature  $t_{in}$  to estimate the efficiency of engine intake air cooling at varying loading.

It should be noticed that the correction coefficients received by authors in calculation correlations are supposed to be valid for treating the monitoring data of gas engines JMS 420 GS-N.LC as driving engines operating in a concrete IES.

The method of treating the monitoring data is based on their statistical analysis by sampling the monitoring data on engine full volume fuel consumption as a function of intake air temperature  $t_{in}$ :  $B_f = f(t_{in})$  at varying engine electric power  $P_{el}$ .

A time interval of measurements in a stable mode was  $\tau = 1...30$  s, a number of measurements in a stable mode – 8...240.

Monitoring data sets  $B_f = f(t_{in})$  and  $P_{el} = f(t_{in})$  were formed at different engine loading  $P_{el}/P_{el,ISO} = 0.6...1.0$ , where  $P_{el}$  and  $P_{el,ISO}$  – actual engine load and nominal engine load rated at ISO parameters [39].

The main measurement devices and their ranges of measurements and accuracy are indicated in Table 1.

**Table 1.** Measurement devices

№	Parameter	Measurement device	Range of measurements	Accuracy class, error
1	Relative humidity of air	Sensor of humidity and temperature– DVT-01 ("RegMik")	0...100 %	± 2 %
2	Temperature of ambient air		–40...+120 °C	± 0.5 °C
3	Temperature of intake air	Temperature sensor– TSMU-0124 (NPF "RegMik")	0...+120 °C	± 0.5 °C
4	Volume flow of fuel gas	Ultrasonic gas meter – KURS-01 G250 A1	1.6...400 m <sup>3</sup> /h	± 1 %
5	Electric power	Electricity meter SL 7000 Smart (SL761)	1...120%	± 0.5 %

As an example, the magnitudes of errors in determining the engine volume fuel gas consumption within the confidence interval  $P = 0.95$  for measurements conducted in July 2019 are shown in Table 2.

The error of experimental data was determined by taking into consideration the error of measuring instruments, methodological and systematic errors and was about 5-6 %.

**Table 2.** The values of errors in determining the consumption of engine volume fuel gas  $B_f$

№	Volume consumption of fuel gas $B_e, \text{ m}^3/\text{h}$	Relative errors			
		Systematic errors $\Delta B_f/B_f$	Confidence probability $P = 0.95$	Confidence interval $B_f, \text{ m}^3/\text{h}$	Overall relative errors including methodological errors $\Delta B_f/B_f$
			$\Delta B_f/B_f$		
1	359.1	0.0090	0.0004	1.10	0.049
2	359.3	0.0098	0.0006	1.70	0.050
3	358.2	0.0091	0.0004	1.20	0.050
4	356.1	0.0091	0.0002	0.70	0.049
5	361.4	0.0093	0.0020	5.70	0.051
6	360.5	0.0104	0.0012	3.30	0.052

The results of monitoring fuel efficiency of GE JMS 420 GS-NL were presented in the form of data sets on dependence of full volume fuel consumption  $B_f = f(t_{in})$  and engine electric power  $P_{el} = f(t_{in})$  on the air temperature  $t_{in}$  at the intake of engine at varying loading.


The monitoring values of specific volume fuel consumption  $b_f$  was determined by full volume fuel consumption  $G_f$  and electric power output  $P_{el}$ :  $b_f = G_f / P_{el}$ ,  $\text{m}^3/(\text{kW}\cdot\text{h})$ , or specific mass fuel consumption  $b_e = b_f \rho_f$ , where  $\rho_f = 661.7 \text{ g/m}^3$  – mass density of gas fuel.

The calculation values of specific mass fuel consumption  $b_e$  was determined by correlation according to generalized methodology presented in [39]:

$$b_e = b_{e.ISO} \cdot \left( \frac{P_{el}}{P_{el.ISO}} \right)^{-0.1015} \cdot \left( \frac{T_{in}}{T_{in.ISO}} \right)^{0.443}, \quad (1)$$

where  $P_{el.ISO} = 1420 \text{ kW}$ ;  $T_{in.ISO} = 298.15 \text{ K}$  ( $t_{in.ISO} = 25^\circ\text{C}$ );  $b_{e.ISO} = 167.764 \text{ (g/kWh)}$ ; 0.443 and  $-0.1015$  – correction coefficients received by authors during treating the monitoring data of gas engine JMS 420 GS-N.LC.

The results of comparison of calculation values of specific mass fuel consumption  $b_{e.calc}$  with monitoring data  $b_{e.monit}$  are presented in Fig.3.

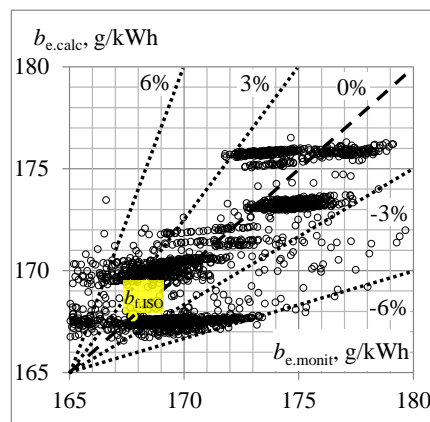


**Figure 3.** The calculated values of mass specific fuel consumption  $b_{e.calc}$  against their monitoring data  $b_{e.monit}$  : point  $b_{e.ISO}$  corresponds to "ISO" climatic parameters [39]

As Fig 3 shows, a deviation of calculated values of mass specific fuel consumption  $b_{f,calc}$  from their monitoring data  $b_{f,monit}$  is about 5-6 %, that proves a satisfactory their agreement.

With this a sample of number of points ( $n/N$ ) corresponding to the approximation with a relative error of not more than 5% was about 95%.

#### 4. Results

A sample of results of monitoring daily changes of full volume gas fuel consumption  $B_f$  and electric power  $P_{el}$  of gas engine JMS 420 GS-N.LC and specific volume  $b_f = B_f / P_{el}$  and mass  $b_e = b_f \rho_f$  fuel consumption in June are presented in Fig. 4.

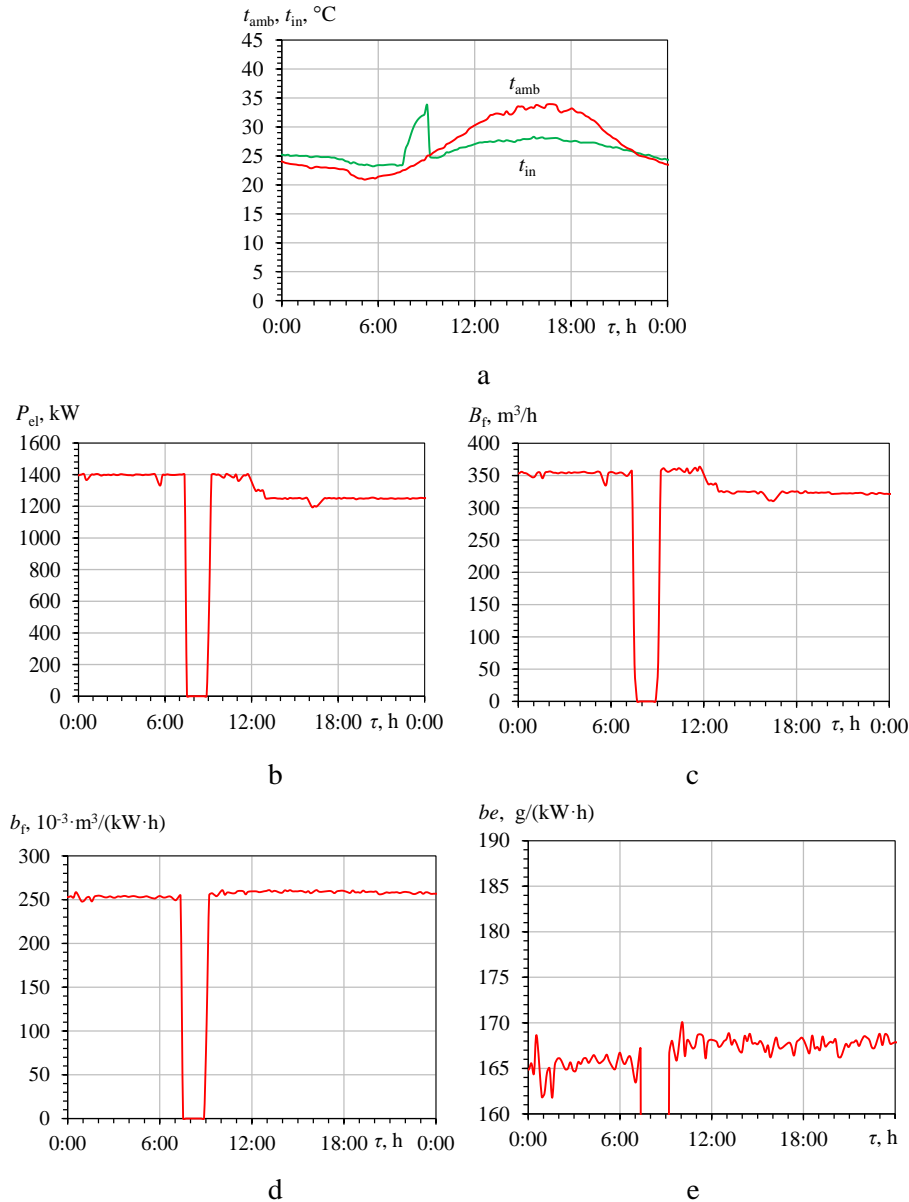


**Figure 4. Daily changes in the ambient air temperature  $t_{amb}$  and engine intake air temperature  $t_{in}$  (a), engine electric power  $P_{el}$  (b), total volume fuel consumption  $B_f$  (c), volume  $b_f$  (d) and mass  $b_e$  (e) specific fuel consumption versus time  $\tau$  (July)**


As Fig. 4, a shows, within time interval  $\tau = 7 \dots 9$  h, when the engine was switched off (Fig.4, b)

and ACh did not feed a chilled water with a rate temperature of 12 °C to the air conditioner for cooling ambient air incoming the engine room, the temperature of the air at the intake of engine  $t_{in}$  is raised sharply by about 10 °C higher than the ambient temperature  $t_{amb}$ . This air temperature increment reflects an increase in the temperature of incoming ambient air caused by heat influx from surroundings in the engine room. As a result of the last, a temperature of the air at the intake of engine  $t_{in}$  remained at increased level during the most daily time after  $\tau = 10$  h, when the engine was switched on (Fig.4, b) and the air conditioner consumed a chilled water from ACh with temperature of 12 °C. This causes increased specific fuel consumption  $b_e$  of about 168 g/(kW·h) compared with 165-166 g/(kW·h) in the night and morning hours before  $\tau = 7$  h (Fig.4, d).


The results of treating the monitoring data on the engine electric power  $P_{el} = f(t_{in})$ , full volume fuel consumption  $B_f = f(t_{in})$  and specific mass fuel consumption  $b_e$  in dependence on temperature  $t_{in}$  of air at the intake of engine JMS 420 GS-N.LC at the loads  $P_{el} = 900-1400$  kW (the values within the range  $P_{el}/P_{el,ISO} = 0.6-1.0$  related to ISO point [39]) are presented in Fig. 5-7.

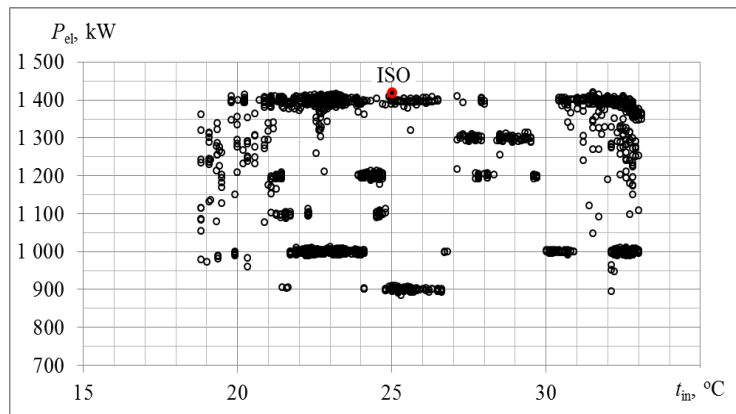

**Figure 5. The values of electric power  $P_{el}$  in dependence on the temperature  $t_{in}$  of air at the intake of engine JMS 420 GS-N.LC at the loads  $P_{el} = 900-1400$  kW**

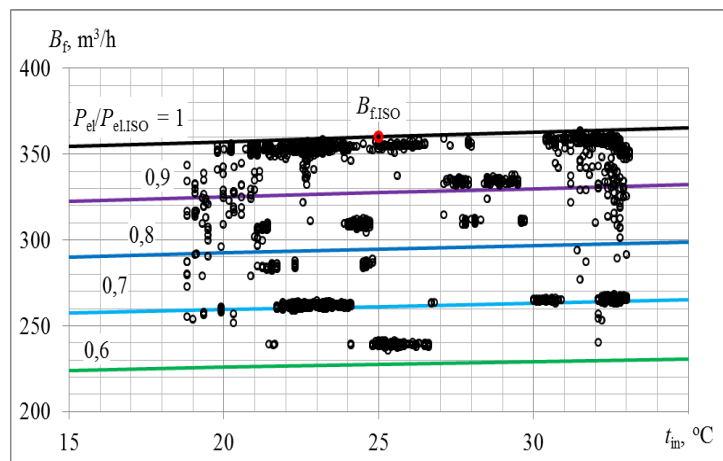


**Figure 6. The values of full volume fuel consumption  $B_f$  in dependence on the air temperature  $t_{in}$  at the intake of engine JMS 420 GS-N.LC at the loads  $P_{el,ISO}/P_{el,ISO} = 0.6-1.0$**

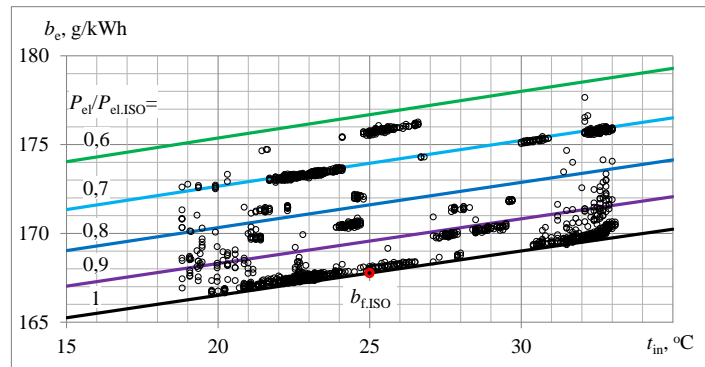

**Figure 7. The values of specific mass fuel consumption  $b_e$  in dependence on the air temperature  $t_{in}$  at the intake of engine JMS 420 GS-N.L.C at the loads  $P_{el,ISO} / P_{el,ISO} = 0.6-1.0$**

As Fig. 7 shows, an increase in air temperature at the intake of engine by 1 °C causes increasing the specific mass fuel consumption  $b_e$  by about 0.25 g/(kW·h).

Proceeding from reducing the specific mass fuel consumption  $b_e$  due to lowering the air temperature  $t_{in}$  at the intake of engine (Fig.7) a concept of deep cooling the intake air lower than in traditional cooling system by chilled water from ACh with temperature of about 12 °C (Fig. 2), generally used for technological duties, is proposed. This can be performed by addition cooling a chilled water from ACh down 5-7 °C to feed the air cooler at the intake of engine with application of ejector chiller (Fig. 8).

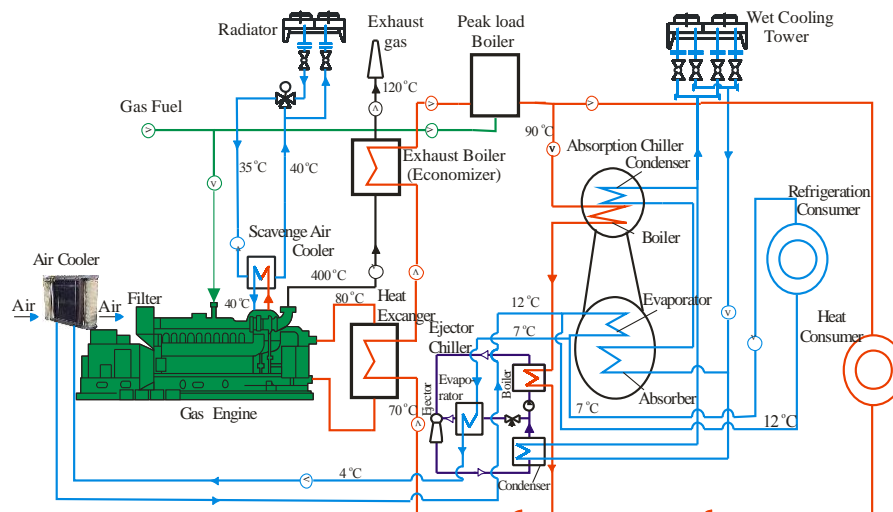

**Figure 8. A proposed system for deep cooling a gas engine intake air by a chilled water from ACh additionally subcooled in ECh**

As another version, a two-stage intake air cooler can be applied with precooling the ambient air to about 20 °C by chilled water from ACh in the first stage and subsequent deep cooling the air to the temperatures 7-10 °C in the second stage of the intake air cooler by using a refrigerant as a coolant.

Such deep cooling the air at the intake of engine provides its temperature drop of 15-20 °C resulting in specific mass fuel consumption reduction of about 2-3 g/(kW·h).



## 5. Conclusions

The fuel efficiency of gas engines is effected by the temperature of air at the turbocharger suction. The data on dependence of fuel consumption and engine electric power on the intake air temperature were monitored for Jenbacher gas engine JMS 420 GS-N.LC to evaluate its influence.

The method for treating the monitoring data on fuel consumption depending on the air temperatures at the engine intake with regard to the influence of changes in engine loads was applied. It uses correlations from the generalized methodology presented in "ISO 3046-1:2002 Reciprocating Internal Combustion Engines – Performance" [39] with correction of the coefficients in calculation correlations on the base of monitoring data of gas engines JMS 420 GS-N.LC operating in a concrete IES.

The method is focused to determine the dependence of specific (volume or mass) fuel gas consumption on the engine intake air temperature to estimate the efficiency of engine intake air cooling at varying loading and to reveal the reserves to enhance the efficiency of traditional cooling system by ACh with chilled water generally used for technological duties.

Issuing from a reduction of the specific fuel consumption due to decreasing air temperature at the intake of engine a concept of deep cooling the intake air lower than traditional cooling by chilled water from ACh with temperature of about 12 °C generally used for technological duties, is proposed. It can be realized in two ways: by addition cooling a chilled water from absorption chiller to about 5-7 °C for feeding engine intake air cooler or by two-stage cooling with precooling ambient air by chilled water from ACh in the first stage and subsequent deep cooling air to the temperatures 7-10 °C in the second stage of intake air cooler by using a refrigerant as a coolant.

In both cases the ejector chiller could be applied as the most simple in design and enabling addition decrease in intake air temperature by about 15-20 °C resulting in specific mass fuel consumption reduction of about 2-3 g/(kW·h). The corresponding scheme of engine intake air cooling system is proposed.

## References

- [1] Cogeneration & Trigeneration –How to Produce Energy Efficiently: A practical Guide for Experts in Emerging and Developing Economies, GIZ GmbH, 2016, 144 p.
- [2] Zhao Yang, Wen-Bin Wang, Thermal Modeling and Operating Tests for a Gas Engine Driven Heat Pump Working as a Water Heater in Winter, *Energy and Buildings*, 58 (2013), pp. 219–226
- [3] Payrhuber K., Trapp C., GE's New Jenbacher Gas Engines with 2-Stage Turbocharging, 7 Internationale Energiewirtschaftstagung an der TU Wien IEWT, 2011, 14 p.
- [4] Christian Trapp, *et al.*, Die neue Gasmotorengeneration von GE Jenbacher - mit zweistufiger Aufladung zu höchsten Wirkungsgraden, 32, Internationales Wiener Motorensymposium, 2011
- [5] Trushliakov, E., *et al.*, Increasing the Operation Efficiency of Air Conditioning System for Integrated Power Plant on the Base of its Monitoring, *Proceedings* (Nechyporuk M. et al. (eds), Integrated Computer Technologies in Mechanical Engineering), Advances in Intelligent Systems and Computing, ICTM 2019, Springer, Cham, 2020, Vol. 1113, pp. 351-360

- [6] Andi, B., *et al.*, Experimental Analysis of Triple Fluid Vapour Absorption Refrigeration System Driven by Electrical Energy and Engine Waste Heat, *Thermal Science*, 23 (2019), 5B, pp. 2995-3001
- [7] Umberto, Lucia, Adsorber efficiency in adsorption refrigeration, *Renewable and Sustainable Energy Reviews*, 20 (2013), pp. 570–575
- [8] Sur, A., *et al.*, Influence of Initial Bed Temperature on Bed Performance of an Adsorption Refrigeration System, *Thermal Science*, 22 (2018), 6A, pp. 2583-2595
- [9] Forduy, S., *et al.*, Enhancing the Fuel Efficiency of Gas Engines in Integrated Energy System by Chilling Cyclic Air, *Proceedings* (Tonkonogyi V. et al. (eds), Lecture Notes in Mechanical Engineering), Grabchenko's International Conference on Advanced Manufacturing Processes, InterPartner-2019, Springer, Cham, 2020, pp. 500-509
- [10] Radchenko A., *et al.*, Increasing Electrical Power Output and Fuel Efficiency of Gas Engines in Integrated Energy System by Absorption Chiller Scavenge Air Cooling on the Base of Monitoring Data Treatment, *Proceedings*, HTRSE-2018, E3S Web of Conferences 70, 2018, art. no. 03011, 6p.
- [11] Kornienko, V., *et al.*, Characteristics of the Rotary Cup Atomizer Used as Afterburning Installation in Exhaust Gas Boiler Flue, *Proceedings* (Ivanov V. et al. (eds), Lecture Notes in Mechanical Engineering), Advances in Design, Simulation and Manufacturing III, DSMIE 2020, Springer, Cham, 2020, pp. 302-311
- [12] Kornienko, V., *et al.*, Improving the Efficiency of Heat Recovery Circuits of Cogeneration Plants with Combustion of Water-Fuel Emulsions, *Thermal Science, OnLine-First (00)* (2020), pp. 154-154
- [13] Lee, Tzong-Shing, Lu, Wan-Chen, An Evaluation of Empirically-Based Models for Predicting Energy Performance of Vapor-Compression Water Chillers, *Applied Energy*, 87 (2010), pp. 3486–3493
- [14] Trushliakov, E., *et al.*, The Efficiency of Refrigeration Capacity Regulation in the Ambient Air Conditioning Systems, *Proceedings* (Ivanov V. et al. (eds), Lecture Notes in Mechanical Engineering), Advances in Design, Simulation and Manufacturing III, DSMIE 2020, Springer, Cham, 2020, pp. 343-353.
- [15] Radchenko, A., *et al.*, Analysis of the Efficiency of Engine Inlet Air Chilling Unit with Cooling Towers, *Proceedings* (Ivanov V. et al. (eds), Lecture Notes in Mechanical Engineering), Advances in Design, Simulation and Manufacturing III, DSMIE 2020, Springer, Cham, 2020, pp. 322-331
- [16] Yang, Zhao, *et al.*, Thermal Modeling and Operating Tests for a Gas-Engine Driven Heat Pump Working as a Water Heater in Winter, *Energy and Buildings*, 58 (2013), pp. 219-226
- [17] Radchenko, A., *et al.*, Rational Designing of Gas turbine Inlet Air Cooling System, *Proceedings* (Tonkonogyi V. et al. (eds), Lecture Notes in Mechanical Engineering), Grabchenko's International Conference on Advanced Manufacturing Processes, InterPartner-2019, Springer, Cham, 2020, pp. 591-599.

- [18] Garimella, Srinivas, Low-Grade Waste Heat Recovery for Simultaneous Chilled and Hot Water Generation, *Applied Thermal Engineering*, 42 (2012), pp. 191-198
- [19] Trushliakov, E., *et al.*, Statistical Approach to Improve the Efficiency of Air Conditioning System Performance in Changeable Climatic Conditions, *Proceedings*, 5th International Conference on Systems and Informatics, ICSAI 2018, Jiangsu, Nanjing, China, 2018, pp. 1303-1307
- [20] Air Conditioners, Liquid Chilling Packages and Heat Pumps, with Electrically Driven Compressors, for Space Heating and Cooling—Testing and Rating at Part Load Conditions and Calculation of Seasonal Performance, BS EN 14825:2016, BSI Standards: London, UK, 2016
- [21] Lawrence, N., Elbel, S., Experimental Investigation of a Two-Phase Ejector Cycle Suitable for Use with Low-Pressure Refrigerants R134a and R1234yf, *International Journal of Refrigeration*, 38 (2014), pp. 310-322
- [22] Radchenko, R., *et al.*, Enhancing the Efficiency of Marine Diesel Engine by Deep Waste Heat Recovery on the Base of Its Simulation Along the Route Line, *Proceedings* (Nechyporuk M. et al. (eds), Integrated Computer Technologies in Mechanical Engineering), Advances in Intelligent Systems and Computing, ICTM 2019, Springer, Cham, 2020, Vol. 1113, pp. 337-350
- [23] Radchenko, M., *et al.*, Enhancement of the Operation Efficiency of the Transport Air Conditioning System, *Proceedings* (Ivanov V. et al. (eds), Lecture Notes in Mechanical Engineering), Advances in Design, Simulation and Manufacturing III, DSMIE 2020, Springer, Cham, 2020, pp. 332-342
- [24] Bohdal, T., *et al.*, Investigation of Flow Structures During HFE-7100 Refrigerant Condensation, *Archives of Thermodynamics. Polish Academy of Sciences*, 4 (2015), 36, pp. 25-34
- [25] Radchenko, M., *et al.*, Increasing the Operation Efficiency of Railway Air Conditioning System on the Base of its Simulation Along the Route Line, *Proceedings* (Nechyporuk M. et al. (eds), Integrated Computer Technologies in Mechanical Engineering), Advances in Intelligent Systems and Computing, ICTM 2019, Springer, Cham, 2020, Vol. 1113, pp. 461-467
- [26] Trushliakov, E., *et al.*, An Innovative Air Conditioning System for Changeable Heat Loads, *Proceedings* (Tonkonogyi V. et al. (eds), Lecture Notes in Mechanical Engineering), Grabchenko's International Conference on Advanced Manufacturing Processes, InterPartner-2019, Springer, Cham, 2020, pp. 616-625
- [27] Radchenko, N., On Reducing the Size of Liquid Separators for Injector Circulation Plate Freezers, *International Journal of Refrigeration*, 5 (1985), 8, pp. 267–269
- [28] Konovalov, D., *et al.*, Experimental Research of the Excessive Water Injection Effect on Resistances in the Flow Part of a Low-Flow Aerothermopressor, *Proceedings* (Ivanov V. et al. (eds), Lecture Notes in Mechanical Engineering), Advances in Design, Simulation and Manufacturing III, DSMIE 2019, Springer, Cham, 2020, pp. 292-301
- [29] Konovalov, D., *et al.*, Research of the Aerothermopressor Cooling System of Charge Air of a Marine Internal Combustion Engine under Variable Climatic Conditions of Operation, *Proceedings* (Tonkonogyi V. et al. (eds), Lecture Notes in Mechanical Engineering),

Grabchenko's International Conference on Advanced Manufacturing Processes, InterPartner-2019, Springer, Cham, 2020, pp. 520-529

- [30] Radchenko, A., *et al.*, Monitoring the Fuel Efficiency of Gas Engine in Integrated Energy System, *Proceedings* (Nechyporuk M. et al. (eds), Integrated Computer Technologies in Mechanical Engineering), Advances in Intelligent Systems and Computing, ICTM 2019, Springer, Cham, 2020, Vol. 1113, pp. 361-370
- [31] Radchenko, R., *et al.*, Gas Turbine Unite Unlet Air Cooling by Using an Excessive Refrigeration Capacity of Absorption-Ejector Chiller in Booster Air Cooler, *Proceedings*, HTRSE-2018, E3S Web of Conferences 70, art. no. 03012, 2018, 6 p.
- [32] Tian, Y., A Study on the Effectiveness of Fresh Air Units in Temperature and Humidity Independent Control System, *Procedia Engineering*, 205 (2017), pp. 596-602
- [33] Preda, Thermal Image Building Inspection for Heat Loss Diagnosis, *Journal of Physics: Conference Series*, Conference: SEA-CONF 2019, Constanta, Romania, 2019, Vol. 1297
- [34] Fengxia, H., *et al.*, Experimental Study on the All-fresh-air Handling Unit with Exhaust Air Energy Recovery. *Energy Procedia*, Vol. 152, October 2018, pp. 431-437.
- [35] Volintiru, O. N., *et al.*, Optimization of the Ventilation System for Special Ships, *Journal of Physics: Conference Series*, 1122 (2018), 1, art. no. 012034
- [36] Coskun C., A Novel Approach to Degree-Hour Calculation: Indoor and Outdoor Reference Temperature Based Degree-Hour Calculation, *Energy*, 35 (2010), pp. 2455-2460
- [37] Lozano M, *et al.*, Cost Optimization of the Design of CHCP (Combined Heat, Cooling and Power) Systems under Legal Constraints, *Energy*, 35 (2010), pp. 794–805
- [38] Kavvadias, K., Maroulis, Z., Multi-Objective Optimization of a Trigeneration Plant, *Energy Policy*, 38 (2010), pp. 45–54
- [39] ISO 3046-1:2002 Reciprocating Internal Combustion Engines – Performance – Part 1: Declarations of Power, Fuel and Lubricating Oil Consumptions, and Test Methods – Additional Requirements for Engines for General Use, 2014, <https://www.iso.org/standard/28330.html>

Paper submitted: 11 July 2020  
Paper revised: 20 November 2020  
Paper accepted: 29 November 2020