

# THERMAL RECOVERY TEST FOR DETERMINING THE THERMAL CONDUCTIVITY OF THE SOIL

*Marija M. VASILEV<sup>\*1</sup>, Miloš J. BANJAC<sup>1</sup>*

<sup>\*1</sup>Department of Thermomechanics, Faculty of Mechanical Engineering, University of Belgrade, Belgrade, Serbia

<sup>\*</sup> Corresponding author; E-mail: mvasilev@mas.bg.ac.rs

*This paper presents a new in-situ experimental procedure for determining a thermal conductivity of soil, as one of the thermophysical properties necessary for dimensioning vertical buried heat exchangers of geothermal heat pumps. The proposed method, called the Thermal Recovery Test, is based on the assumption that there is a direct analogy between the hydrodynamic process of filling (recovery) the well with water from a porous aquifer after its partial or complete discharging and the process of establishment of thermal equilibrium in an infinite medium previously disturbed by a line heat sink (source). Apart from presentation the theoretical background of these two phenomena, the display of the identical theoretical logarithmic character of the change of hydrostatic pressure and soil temperature, description of the experimental procedure, the experimental results of three performed experiments are also presented. Additionally, results for the experimentally obtained values of the thermal conductivity of the soil are compared with those obtained from the Thermal Response Test, and the advantages and drawbacks of the new Thermal Recovery Test method are analyzed.*

*Key words: thermal conductivity of soil, vertical buried heat exchangers, Thermal Response Test, Thermal Recovery Test*

## 1. Introduction

Non-renewable fuels like coal, oil and gas have the most significant role in driving worldwide climate shifts, responsible for more than 75% of total global greenhouse gas emissions and nearly 90% of carbon dioxide emissions [1]. In order to mitigate the most severe consequences of climate change, it's imperative to reduce CO<sub>2</sub> emissions. The most common and simplest ways to achieve a reduction of CO<sub>2</sub> emissions are by reducing energy consumption or producing energy without CO<sub>2</sub> emissions. A production of energy without CO<sub>2</sub> emissions involves systems that utilize renewable energy sources such as hydropower, wind, solar, geothermal energy and biomass. Among these, geothermal energy holds significant potential. When it comes to low-temperature petro or hydro geothermal energy, ground source heat pumps (GSHP) play a vital role in utilizing that energy for heating and cooling applications.

Because of the principles of its operation, GSHP extract additional energy from the ground, enabling it to deliver several times more heat than the consumed electric energy. In the case that these

devices operate using electric energy produced from renewable sources and without additional CO<sub>2</sub> emissions, they can also be considered a type of carbon dioxide absorption systems.

GSHP with vertical borehole heat exchangers (VBHE) are a type of geothermal heating systems. The VBHE comprises a series of vertical boreholes drilled into the ground, typically reaching depths of approximately 100 to 150 meters [2]. These boreholes enable the heat transfer between the circulating fluid in the system and the surrounding soil.

Although the working principle of heat pumps is fully understood and can be described by energy balance equations [3], the performance of geothermal boreholes, which can be represented as linear heat sources/sinks, are insufficiently researched and require simulations and databases.

To ensure adequate performance and energy efficiency of the VBHE within a GSHP system during its design phase, it is necessary to have available data of the thermal properties of the soil such as density, specific heat capacity and especially effective thermal conductivity.

Obtaining precise measurements of effective thermal conductivity of soil can be challenging due to uncertainties related to the soil composition, moisture content, groundwater flows, and air volume fraction [4]. These factors are often not fully known or adequately represented in available data.

In order to overcome these problems, the well-known Thermal Response Test is widely used today to determine the required thermophysical data of soil [5] despite some shortcomings. This test originated from the analytical solution of the problem of a line heat source in an infinite medium, as well as the analogy with the hydraulic potential of the soil and Thiem test [6], used to determine the transmissivity of an aquifer [7].

Building upon the idea of an analogy between the thermal and hydraulic potentials of the soil [8], i.e. an analogy between the hydrostatic pressure field of groundwater during the non-stationary pumping of water from a well and the temperature field formed in the ground during the non-stationary extraction of its internal energy using a vertically buried heat exchanger, it was assumed that it is possible to define and carry out another type of the test for the non-stationary process of soil regeneration that occurs after the completion of its thermal depletion. By analogy with Theis Recovery Test [6, 9], used to determine the transmissivity of the aquifer by observing its spontaneous charging after a period of previous discharging, it was assumed that by monitoring the rate of soil recovery after its thermal loads, suitable analogous relationships could be established. In other words, by analogy, a new method for determining the thermal conductivity of the soil could be established - the Thermal Recovery Test.

## **2. Theoretical background**

### ***2.1.1 Pumping Test and Recovery Test***

The use of wells as sources of drinking water or technical water dates back to the very beginnings of human civilization, and the experimental procedures for determining their transmissivity – such as line hydraulic sinks, represent well-established and familiar methods. Among the numerous methods for determining their capacity of well (or transmissivity of aquifer), probably the most common ones are the so-called Pumping Test and Recovery Test.

In the first method (Pumping Test), the transmissivity of the aquifer is determined by pumping water from the well at a constant rate and observing the decline in water level within the well. If the pumping rate is sufficiently high, due to the limited inflow of water from the surrounding porous soil,

the water level in the well will decrease. Since the inflow of water into the well depends on hydrostatic pressure, this phenomenon can be described by the equations of motion of fluids in porous media (continuity equation), expressed by the hydrostatic pressure in the differential form. That equation actually represents Fourier's differential equation in terms of hydrostatic pressure, which in the case of two-dimensional radial flow in polar coordinates becomes [10]:

$$\frac{\partial^2 p}{\partial r^2} + \frac{1}{r} \frac{\partial p}{\partial r} = \frac{\mu C_t}{k} \frac{\partial p}{\partial t} \quad (1)$$

where  $k$  is permeability,  $\mu$  is fluid viscosity and  $C_t$  is the total compressibility coefficient.


For practical purposes, in Eq. 1, instead of pressure figures piezometric level during pumping  $h$ , or drawdown of piezometric level  $s$ , i.e. a difference between the piezometric level prior to pumping and piezometric level during pumping (Fig. 1), so Eq. 1 becomes:

$$\frac{\partial^2 h}{\partial r^2} + \frac{1}{r} \frac{\partial h}{\partial r} = \frac{S}{Kb} \frac{\partial h}{\partial t} \quad (2)$$

that is:

$$\frac{\partial^2 s}{\partial r^2} + \frac{1}{r} \frac{\partial s}{\partial r} = \frac{S}{Kb} \frac{\partial s}{\partial t} \quad (3)$$

where  $S$  is the dimensionless storativity,  $K$  is hydraulic conductivity and  $b$  is thickness of aquifer layer. A product  $Kb$  actually represents a transmissivity of the aquifer [11], while the relationship between hydraulic conductivity and permeability is  $K = (k\rho g)/\mu$  [12].

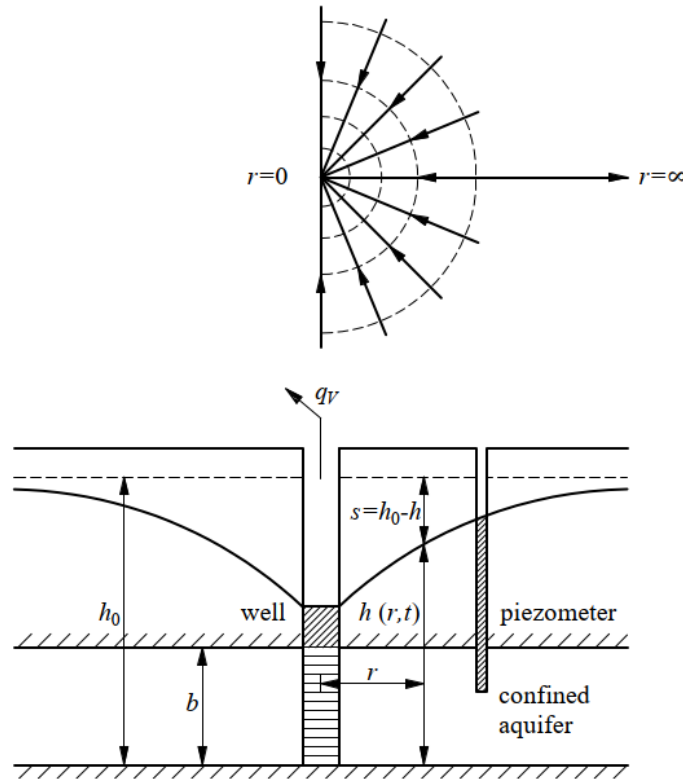

**Figure 1. Display of a test pumping of water from a well with the thickness of the aquifer layer 'b' [12]**

Starting from the previous equation of motion (Eq. 3), Theis (1935) [9] derived the equation for unsteady flow for the previously described case of pumping water from a well:

$$s(r,t) = h_0 - h(r,t) = \frac{q_v}{4\pi Kb} \int_u^\infty \frac{\exp(-u)}{u} du = \frac{q_v}{4\pi Kb} W(u) \quad (4)$$

where  $q_v$  is the constant well discharge or well-pumping rate and  $W(u)$  is the integral of an exponential function, i.e. well function of Theis, the solution of which can be represented as a sum of infinite order:

$$W(u) = -0,5772 - \ln u + u - \frac{u^2}{2 \cdot 2!} + \frac{u^3}{3 \cdot 3!} - \frac{u^4}{4 \cdot 4!} + \dots \quad (5)$$

where  $u$  is:

$$u = \frac{r^2 S}{4Kbt} \quad (6)$$

and  $r$  is distance from the axis of the well and  $t$  is pumping time.


For small values of  $u$  ( $u < 0,01$ ), the drawdown can be approximated as [7]:

$$s(r,t) = \frac{q_v}{4\pi Kb} \left( -0,5772 - \ln \frac{r^2 S}{4Kbt} \right) \quad (7)$$

If the pumping rate ( $q_v$ ) is known, as well as the drawdown ( $s$ ) in hydraulic head in a confined aquifer at any distance  $r$  from a well at any time  $t$  after the start of pumping, it is possible to determine the transmissivity of the aquifer ( $Kb$ ) [7].

The second most commonly used test for determining the transmissivity of the aquifer (or capacity of well) is the so-called Recovery Test. The Recovery Test involves monitoring the rate of water level rise in the well – rate of residual drawdown, from which water has been partially or completely evacuated before. This process is known as the recovery phase of the well (Fig. 2). Because of that Recovery Test can be performed immediately after the termination of the Pumping Test.

It is important to notice that residual drawdown data are more reliable than Pumping Test data due to constant rate of water level rise in the well. The Recovery Test analysis follows the principle of superposition, assuming that the well is recharging at the same rate as discharging.

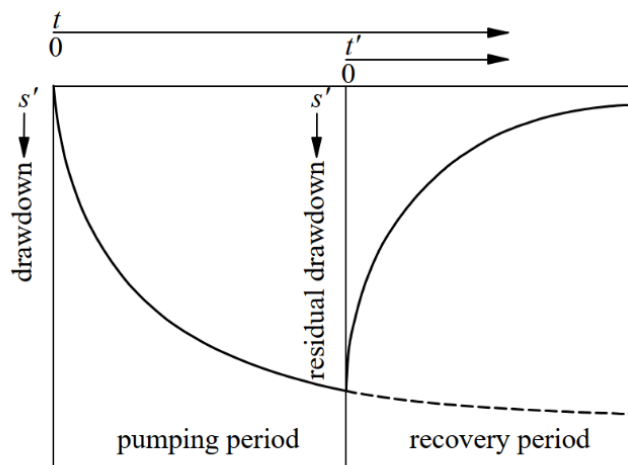

**Figure 2. Change of the drawdown of water during the pumping and the recovery period [7]**

Starting from the same Eq. 3, Theis [9] derived the expression:

$$s' = \frac{q_v}{4\pi Kb} (W(u) - W(u')) \quad (8)$$

where  $s'$  is residual drawdown, and  $u'$ , similarly as  $u$ , is given by:

$$u' = \frac{r^2 S'}{4Kbt'} \quad (9)$$

A time measured from the start of the recovery period is marked with  $t'$ , and storativity during recovery is marked with  $S'$ .

Assuming that  $S = S' = \text{const.}$  and  $Kb = \text{const.}$ , with the condition that  $u$  and  $u'$  are sufficiently small (lower than 0,01), Eq. 8 can be approximated by [7]:

$$s' = \frac{2,3q_v}{4\pi Kb} \log \frac{t}{t'} \quad (10)$$

Finally, it follows from the last equation (Eq. 10) that the transmissivity of the aquifer ( $Kb$ ) can be determined if the pumping rate ( $q_v$ ) and residual drawdown are known ( $s'$ ) [7].

### 2.1.2 Thermal Response Test

The Thermal Response Test has now become widely accepted and almost a standard experimental test for determining the effective thermal conductivity of the soil. This experimental method originated from the analogy with Pumping Test, an established hydrogeological method used for decades to determine transmissivity of the aquifer. The possibility of establishing this analogy is based on the similarity between the behavior of hydrostatic pressure in a porous homogeneous aquifer and the thermal energy in a homogeneous and isotropic solid body. Consequently, the behavior of these two different physical quantities can be described by the same Fourier's differential equation [10].

The Fourier's differential equation for heat conduction in polar coordinates in the two-dimensional case is given by:

$$\frac{\partial^2 T}{\partial r^2} + \frac{1}{r} \frac{\partial T}{\partial r} = \frac{1}{a} \frac{\partial T}{\partial t} \quad (11)$$

where  $T$  is a temperature of the soil and  $a$  is a thermal diffusivity.

Using the analogy between thermal potential and hydraulic potential of the soil and the solution of equations for motion of fluids in porous media (Eq. 7), the solution for heat conduction equation (Eq. 11) for distribution of temperature in an infinite, homogeneous, isotropic medium with a line source that generates heat at a constant intensity can be expressed as follows [4]:

$$T(r, t) = T_0 + \frac{\varphi_l}{4\pi\lambda} \left( -0,5772 - \ln \frac{r^2}{4at} \right) \quad (12)$$

where  $T_0$  is undisturbed temperature of the soil,  $\varphi_l$  is heat rate per unit length,  $\lambda$  is thermal conductivity of the soil and the time condition  $t \geq 5r^2/a$  is considered. If the Eq. 12 is presented in a semi logarithmic coordinate system ( $\ln t - T$ ), the change of soil temperature in the axis of symmetry would represent a straight line. Based on that feature, determined conductivity of the soil is possible

with the determination of the slope of this line. At the same time, it is necessary to know thermal diffusivity of soil, which is one of the disadvantages of this method.

### 2.1.3 Thermal Recovery Test


Upon completion of the Thermal Response Test, i.e. after stop soil heating, due to heat conduction process, soil temperature will decrease, i.e. it will tend to return to its original state. That process is named the thermal recovery of the soil. This process is analogous to the processes of rise in water levels in a well after its previous pumping (rate of residual drawdown). Considering the existence of similarities in hydrodynamic and in thermal phenomena, as well as the already established analogy between Pumping Test and Thermal Response Test, it has been concluded that new experimental method for determining the thermal conductivity of the soil, named the Thermal Recovery Test, can be defined.

Additionally, during data processing on changes in soil temperature during and after the Thermal Response Test, performed in the yard of the Faculty of Mechanical Engineering, University of Belgrade [4, 8], it was observed that the change in soil temperature after completion of the Thermal Response Test process has the same character as changes in the water level in the well during the recovery period of the Recovery Test (Fig. 3). This observation further raised hopes that a new type of test can be defined to determine the thermal conductivity of soil.

Taking into account all the above, it follows that the solution of Eq. 10 can be written in the form:

$$T'(t') = T_0 + \frac{2,3q_l}{4\pi\lambda} \log \frac{t}{t'} \quad (13)$$

where  $T'$  is the temperature of the soil on radius  $r$  in the recovery period (i.e. the arithmetic mean of the inlet and outlet water temperature).

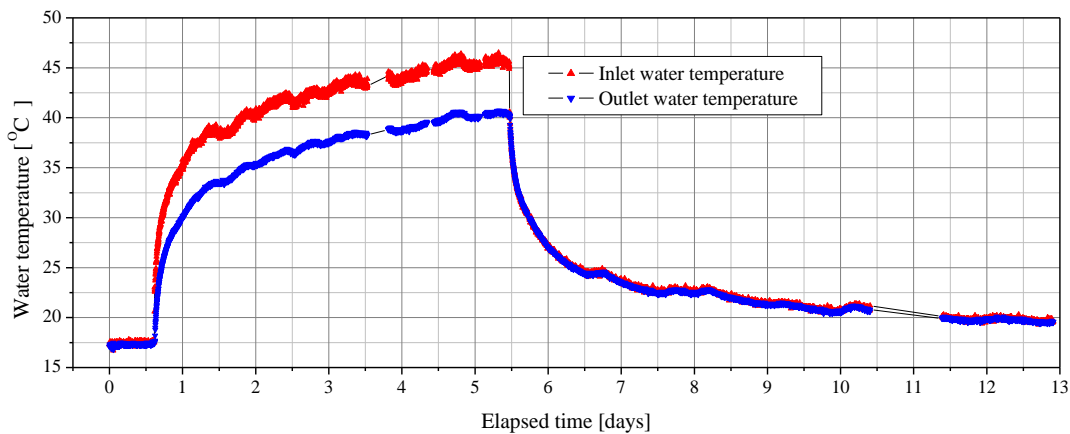

**Figure 3. Change of the water temperature at the entrance to the buried heat exchanger and the exit from it during the preparatory, heating and recovery phases [4, 8].**

By introducing constant  $k_1$  as:

$$k_1 = \frac{2,3q_l}{4\pi\lambda} \quad (14)$$

the Eq. 13 can be written as:

$$T'(t') = T_0 + k_1 \log \frac{t}{t'} \quad (15)$$

Based on the form of the Eq. 15, it can be again concluded that if it is presented in a semi logarithmic coordinate system ( $\log(t/t') - T'(t')$ ), it would represent a straight line and with the determination of the slope of this line is possible to determine conductivity of the soil:

$$\lambda = \frac{2,3\varphi_l}{4\pi k_1} \quad (16)$$

Table 1 was created in order to make it easier to remark analogies between hydrodynamic processes in a porous aquifer and thermal processes in an half infinite medium.

**Table 1. Analogical comparison between hydraulic and thermal flow.**


Hydrodynamic processes in a porous aquifer	Thermal processes in a half infinite medium
Process	
Flow of water	Heat conduction
<i>Analogous laws</i>	
Darcy's law $q_v = -\frac{k}{\mu} A \frac{\partial p}{\partial x}$	Fourier's law $\Phi = -\lambda A \frac{\partial T}{\partial x}$
<i>Analogous tests</i>	
Pumping Test	Thermal Response Test
Recovery Test	Thermal Recovery Test
<i>Fourier's differential equation</i>	
in terms of piezometric level $s$ $\Delta^2 s = \frac{S}{Kb} \frac{\partial s}{\partial t}$	in terms of temperature of soil $T$ $\Delta^2 T = \frac{\rho c_p}{\lambda} \frac{\partial T}{\partial t}$
in polar coordinates $\frac{\partial^2 s}{\partial r^2} + \frac{1}{r} \frac{\partial s}{\partial r} = \frac{S}{Kb} \frac{\partial s}{\partial t}$	in polar coordinates $\frac{\partial^2 T}{\partial r^2} + \frac{1}{r} \frac{\partial T}{\partial r} = \frac{\rho c_p}{\lambda} \frac{\partial T}{\partial t}$
<i>Solution to equation Fourier's differential equation</i>	
$s(r,t) = \frac{q_v}{4\pi Kb} \int_0^t \frac{e^{-\frac{r^2 S}{4Kbt}}}{t} dt$	$T(r,t) = T_0 + \frac{\varphi_l}{4\pi\lambda} \int_0^t \frac{e^{-\frac{r^2}{4\alpha t}}}{t} dt = T_0 + \frac{\varphi_l}{4\pi\lambda} W(u)$
Solution to Pumping Test $s(r,t) = \frac{q_v}{4\pi Kb} \left( -0,5772 - \ln \frac{r^2 S}{4\pi Kb} \right)$	Solution to Thermal Response Test $T(r,t) = T_0 + \frac{\varphi_l}{4\pi\lambda} \left( -0,5772 - \ln \frac{r^2}{4\alpha t} \right)$

### 3. Experimental procedure and results

#### 3.1. Description of the experimental installation

The experimental installation for performing the Thermal Recovery Test shown in Fig. 4 is identical to the instalataton for performing the Thermal Response Test. It consists of a vertical heat exchanger, 60 m long, buried in a vertical, 16.5 cm diameter borehole (subsequently filled with bentonite), electric boiler, water pump, ultrasonic volumetric flow meter and thermometers.

Water was used as the working fluid. The water flow was provided by Grundfos UPBasic 25-4 water pumps. Termomont's electric boiler ETK(E)-9, with a heating capacity of 4.5 kW, was used to heat the water. Danfoss ultrasonic heat meter - SONOMETER TM 1000 equipped with temperature sensors was used as the only measuring equipment for measuring and recording data.

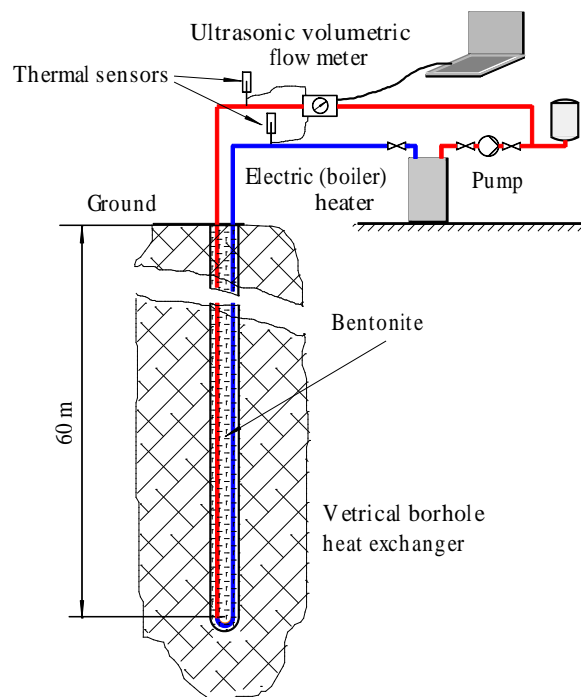

**Figure 4. Sheme of experimental installation for determining the thermal conductivity of the soil by Thermal Response Test [4, 8] and by Thermal Recovery test**

#### 3.2. Measuring procedure

The whole experiment was carried out in the laboratory and above the vertical heat exchanger buried in borehole located in the backyard of the Faculty of Mechanical Engineering, University of Belgrade. A necessary preparatory phase for the execution of the Thermal Recovery Test is the process of heating the soil. During the soil heating phase, the rate of heat generation from the heat source was determined and the average heat flow value of 4489 kW was recorded.

Since the soil heating procedure is identical to that used to perform the Thermal Response Test, this preparatory soil heating phase was used to collect the data necessary to perform a control Thermal Response Test. The detailed description of the measuring procedure of Thermal Response Test is




given in [4, 8]. After that preparatory phase, the Thermal Recovery Test can be executed. At this Thermal Recovery Test phase, the electric heater is turned off and the water driven by the pump continues to flow through the heat exchanger, changing its temperature in accordance with the change in temperature of soil.

In order to obtain data about the change of the temperature of the line heat source during the both the soil heating phase and Thermal Recovery Test phase water temperatures at the entrance to the VBHE (incoming fluid temperature  $T_{in}$ ) and at the exit from it (outgoing fluid temperature  $T_{out}$ ) were measured and recorded. The measured temperature values are shown in Fig. 5.

The data was recorded every 2 minutes. These temperature values were used to determine the average water temperature as their arithmetic mean.

To check the reproducibility of the experiment measurements for Thermal Response Test and Thermal Recovery Test were executed three times with one month time break. The first measurement lasted for 3 days, the second for 7 days, and the third for 9 days.

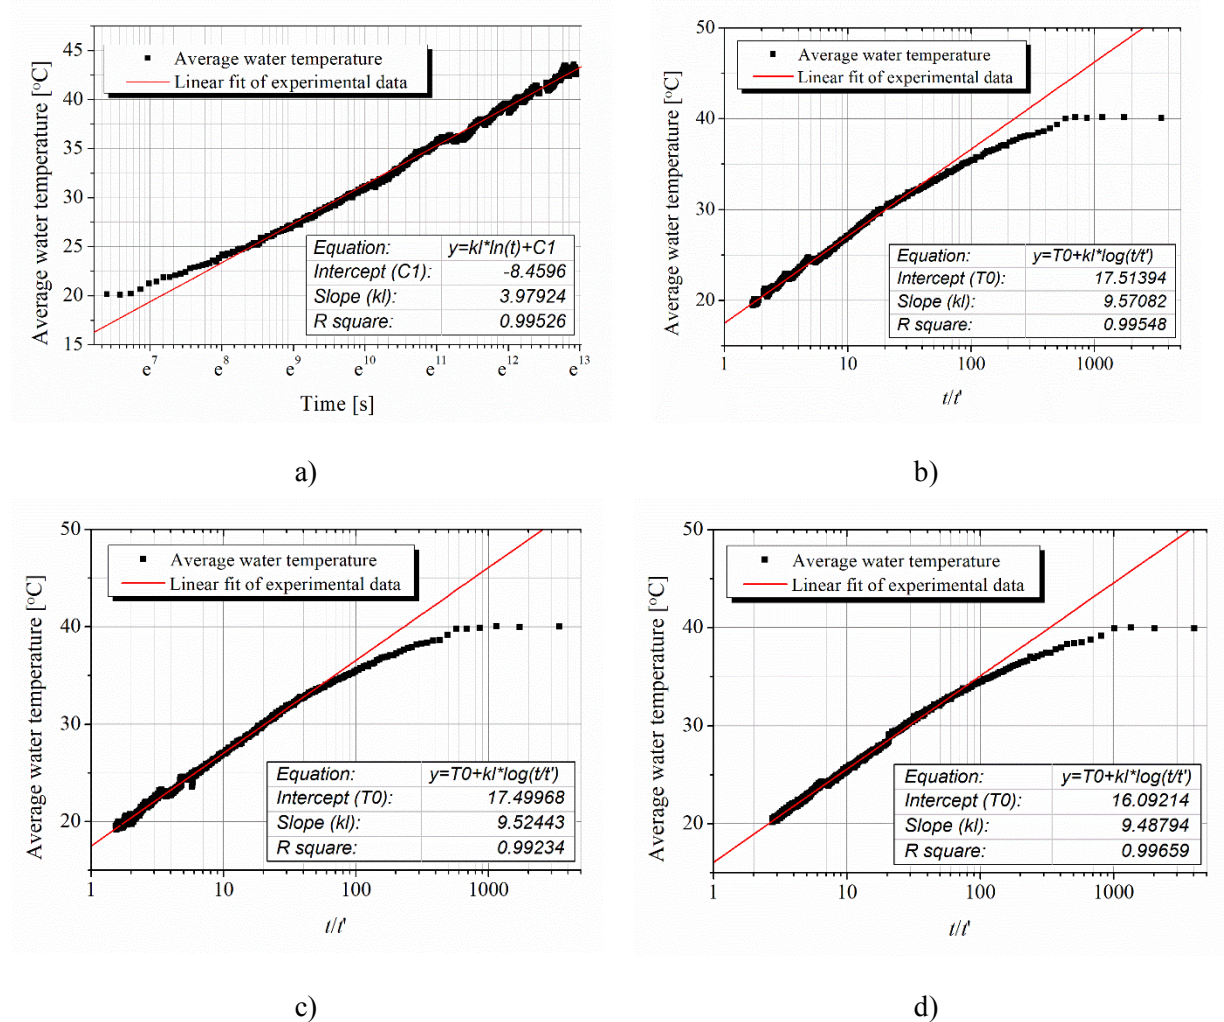

**Figure 5. Change in the average water temperature in VBHE and determination of the slope of the straight line, i.e. the thermal conductivity of the soil: a) during the heating phase – measurement No. 1; b) during the recovery phase – measurement No. 1; c) during the recovery phase – measurement No. 2; d) during the recovery phase – measurement No. 3**

### 3.3. Results and discussion

The arithmetic mean of two temperature values measured at the inlet and outlet of the VBHE represents the average water temperature used for data analysis. The average water temperature is presented on a semi-logarithmic diagram on the ordinate, while the ratio  $(t/t')$  is represented on the abscissa on a logarithmic scale (Fig. 5). A linear fit of the experimental data was achieved using software Origin Pro 8.5, whereby the part of the experimental data from the beginning of the process was excluded in accordance with condition  $u' < 0,1$  (i.e.  $t' > 2,5r^2/a$ ) [7].

For the purposes of Thermal Response Test, it was assumed that the thermal diffusivity of the soil, is  $a = 10 \cdot 10^{-7} \text{ m}^2/\text{s}$  [13, 14], which was experimentally found to be made of clay.

A result for the Thermal Response Test for the first experiment, according to [4] and three Thermal Recovery Tests are shown in the Fig. 5 (a, b, c, d). Based on the slope of the straight line ( $k_1$ ) obtained by the linear fitting in the software Origin Pro 8.5 and Eq. 16, the values of the thermal conductivity of the soil were determined for all three cases. These results and results for the thermal conductivity obtained from the heating phase - Thermal Response Test, according to [4] are presented in Tab. 2. By comparing the results, it can be concluded that values of thermal conductivity for all three experiments of the Thermal Recovery Test are close and differ by less than 1%, indicating that this method provides increased accuracy compared to the Thermal Response Test, whose values differ by about 3,6%. Also, it can be noticed that values of the thermal conductivity obtained from the Thermal Recovery Test are on average about 2,55% lower than those obtained by the Thermal Response Test.

**Table 2. Experimentally obtained values of the thermal conductivity of the soil in the same borehole in three different Thermal Recovery and Thermal Response Tests**

No. of measurements	$\lambda [\text{Wm}^{-1}\text{K}^{-1}]$	
	Thermal Recovery Test	Thermal Response Test
1	1.431	1.496
2	1.438	1.442
3	1.443	1.488

### 4. Conclusion

In order to properly design vertically buried heat exchangers in the ground, as part of geothermal heat pump systems, it is necessary to have data about the thermal properties of the soil, among which thermal conductivity of the soil is the most important. The widely accepted *in-situ* method for determining this variable is the Thermal Response Test. To overcome the shortcomings of this experimental method, such as inaccuracies caused by disturbances due to fluctuations in the public electricity grid, which is the usual power supply mode during the Thermal Response Test, then overcoming affected by the outdoor air temperature and necessity to inadvance predict value of the thermal diffusivity of the soil, a new *in-situ* experimental procedure for determining a thermal conductivity of soil is proposed and presented. The proposed method, called the Thermal Recovery Test, is based on the assumption that there is a direct analogy between the hydrodynamic process of

filling (recovery) the well with water from a porous aquifer after its partial or complete discharging and the process of establishment of thermal equilibrium in an infinite medium previously disturbed by a line heat sink (source).

In order to check the correctness of these assumptions and the quality of this newly proposed test, its validity and accuracy was checked experimentally. The experiment was conducted in the backyard of the Faculty of Mechanical Engineering in Belgrade. Based on the experimentally obtained data, it was concluded that values of thermal conductivity for all three experiments of the Thermal Recovery Test are close and differ by less than 1%, indicating that this method provides increased accuracy compared to the Thermal Response Test, whose values differ by about 3,6%. Also it was noticed that values of the thermal conductivity obtained from the Thermal Recovery Test are on average about 2,55% lower than those obtained by the Thermal Response Test. Based on that, it can be concluded that the Thermal Recovery Test compared to Thermal Response Test has higher accuracy, is more reliable and has better repeatability, which makes it superior and more reliable test. As the only shortcoming of this test could be the significantly longer time required for its performance, and therefore additional financial expenses.

## Acknowledgment

This paper is made in a scope of the project TR 33047 “Intelligent climate control systems to achieve energy efficient regime in the complex conditions of exploitation” funded by the Ministry of Education, Science and Technological Development of the Republic Serbia.

## Nomenclature

- $a$  - thermal diffusivity [ $\text{m}^2\text{s}^{-1}$ ]
- $b$  - thickness of the aquifer layer [m]
- $C_t$  - total compressibility coefficient [ $\text{Pa}^{-1}$ ]
- $g$  - gravitational constant [ $\text{ms}^{-2}$ ]
- $h$  - piezometric level [m]
- $h_0$  - piezometric level before start of pumping [m]
- $k$  - permeability [ $\text{m}^2$ ]
- $K$  - hydraulic conductivity [ $\text{ms}^{-1}$ ]
- $p$  - hydrostatic pressure [Pa]
- $q_v$  - constant well discharge or well-pumping rate, i.e. volumetric flow rate [ $\text{m}^3\text{s}^{-1}$ ]
- $r$  - radial coordinate, i.e. distance from the axis of the well [m]
- $s$  - drawdown [m]
- $s'$  - residual drawdown [m]
- $S$  - storativity [-]
- $S'$  - storativity during recovery [-]
- $T$  - temperature of the soil, i.e. arithmetic mean of the inlet and outlet water temperature – heat injection period [K]
- $T'$  - temperature of the soil, i.e. arithmetic mean of the inlet and outlet water temperature – recovery period [K]
- $T_0$  - undisturbed temperature of the soil, before heat injection [K]

$t$  - time [s]

$t'$  - time measured from the start of the recovery period [s]

### Greek letters

$\varphi_l$  - heat rate per unit length,  $\varphi_l = \Phi/l$  [ $\text{Wm}^{-1}$ ]

$\lambda$  - thermal conductivity of the soil [ $\text{Wm}^{-1}\text{K}^{-1}$ ]

$\mu$  - fluid viscosity [Pas]

$\rho$  - density [ $\text{kgm}^{-3}$ ]

### References

- [1] \*\*\*, <https://www.un.org/en/climatechange/raising-ambition/renewable-energy>
- [2] Verdoya, M., *et al.*, Thermophysical parameters from laboratory measurements and *in-situ* tests in borehole heat exchangers, *Applied Thermal Engineering* (2018), doi: <https://doi.org/10.1016/j.applthermaleng.2018.08.039>
- [3] Hepbasli, A., Thermodynamic analysis of a ground-source heat pump system for district heating, *International journal of energy research*, 2005, pp. 671-687
- [4] Banjac, M. J., *et al.*, Experimental determination of thermal conductivity of soil with a thermal response test, *Thermal science*, 2012, Vol. 16, No. 4, pp. 1117-1126, <https://doi.org/10.2298/TSCI100627156B>
- [5] Signhild, G., Thermal response test (Method Development and Evaluation), Ph. D. thesis, Lulea University of Technology, Lulea, Sweden, 2002
- [6] Thiem, G., Hydrological methods, Ph. D. thesis, Leipzig, 1906
- [7] Kruseman, G. P., De Ridder, N. A., *Analysis and Evaluation of Pumping Test Data*, International Institute for Land Reclamation and Improvement, P.O. Box 45, 6700 AA Wageningen, The Netherlands, 1994
- [8] Banjac, M. J., Eksperimentalno određivanje toplotnih svojstava zemljišta kao izvora toplote za geotermalne toplotne pumpe, *Termotehnika*, 2010, Vol. 36, No. 1, pp. 109-117
- [9] Theis, C.V., The relation between the lowering of the piezometric surface and the rate and duration of discharge of a well using groundwater storage, *Transactions on American Geophysical Union*, Washington DC, 1935, Vol. 16, pp. 518-524
- [10] Xue, L., *et al.*, *Fluid Flow in Porous Media (Fundamentals and Applications)*, Beijing, China, 2020, <https://doi.org/10.1142/11805>
- [11] Harvey, C., Groundwater Hydrology, Institute of technology, Massachusetts
- [12] Freeze, R. A., Cherry, J. A., *Groundwater*, Prentice-Hall, Inc., Englewood Cliffs, N. J., 1979, ISBN: 0-13-365312-9
- [13] Dong, Y., *et al.*, Critical Review of Thermal Conductivity Models for Unsaturated Soils, *Geotechnical and Geological Engineering*, 2015, pp. 207–221, <https://doi.org/10.1007/s10706-015-9843-2>
- [14] Loveridge, F., *et al.*, Thermal response testing through the Chalk aquifer in London, UK, *Proceedings of the Institution of Civil Engineers, Geotechnical Engineering*, 2012, Vol. 166, pp. 197-210, <http://dx.doi.org/10.1680/geng.12.00037>

Submitted: 25.8.2023  
Revised: 28.9.2023  
Accepted: 13.10.2023